

ENGINEERING DATA

THERMALLY CONDUCTIVE, PATENTED ALUMINUM CORE

The cross-flow heat recovery core transfers heat between the two airstreams. It is easily removed for cleaning or service.

MOTORS AND BLOWERS

Each airstream has one centrifugal blower driven by a common PSC motor with multiple fan speed operations.

FILTERS

Washable air filters in exhaust and supply airstreams.

MOUNTING THE HRV

Threaded inserts at corners of the cabinet designed to accept the "S" hooks and hanging straps supplied with the unit.

DEFROST

Recirculating damper defrost system.

CASE

20 gauge prepainted galvanized steel for superior corrosion resistance, insulated to prevent exterior condensation. Drain connection Two 1/2 in (12 mm) OD.

INSTALLER SELECTABLE HIGH SPEED SETTINGS

Adjustable DIP switches are located on the circuit board, Hi3 is the factory setting. Refer to the Installation manual for the adjustment instructions.

ELECTRONICS

The control can be wall mounted in a central location of the home. 3 wire 20 gauge (min.) 100 ft length (max.).

CONTROL OPTIONS

99-DXPL02 Lifebreath Digital Control

- 5 speed operation on each mode
- Humidity control through adjustable Dehumidistat
- 5 user selectable operational modes: Continuous Ventilation, Continuous Recirculation, 20 ON/40 OFF, 10 ON/50 OFF, 20 ON/40 Recirculation
- 20/40/60 min. High speed override button
- Compatible with 99-DET02 Wireless Timers
- 3 wire connection

99-BC02 Lifebreath Ventilation Control

- 2 speed fan setting (Low/High)
- Humidity control through adjustable Dehumidistat
- Compatible with 99-DET02 Wireless Timers
- 3 wire connection

99-BC03 Lifebreath Ventilation Control

- Continuous Low fan speed
- Humidity control through adjustable Dehumidistat
- 3 modes of operation: Ventilation, Recirculation, 20/40
- Compatible with 99-DET02 Wireless Timers
- 3 wire connection

99-BC04 Lifebreath Ventilation Control

- 2 speed fan setting (Low/High)
- 2 modes of operation: Ventilation, 20/40
- Compatible with 99-DET02 Wireless Timers
- 3 wire connection

99-DH01 Lifebreath Dehumidistat

- Humidity control through adjustable Dehumidistat
- 3 wire connection

TIMER OPTIONS

99-DET01 Lifebreath 20/40/60 Minute Timer - Initiates High speed Ventilation for 20, 40 or 60 minutes. 3 wire connection.

99-DET02 Lifebreath WIRELESS 20/40/60 Minute Timer - Initiates High speed Ventilation for 20, 40 or 60 minutes. Wirelessly connects to main control for ease of installation. 40' approximate range.

99-RX02 Lifebreath WIRELESS Repeater - Used to extend range of 99-DET02 Wireless Timers. Plugs into 120V power outlet. Wirelessly connects to main control and 99-DET02. Install at halfway point between timer and main wall control if timer is out of range.

ACCESSORY OPTIONS


99-163 Duct Heater w/Electronic SCR Thermostat - 1 kW, 6 in (152 mm)

99-185 Weatherhoods - Two 5 in (127 mm)

99-190 Dual Hood - One 6 in (152 mm) opening for supply and exhaust.

DIMENSIONS RNC95

WEIGHT 52 lbs (23.6 kg) **SHIPPING WEIGHT** 56 lbs (25.4 kg)

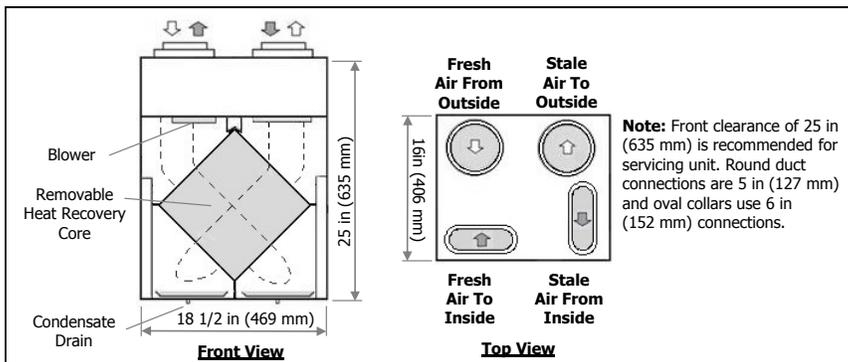


| Performance (HVI certified) | |
|-------------------------------------------------------------------|-------------------|
| Net supply air flow in cfm (L/s) against external static pressure | |
| External Static Pressure | Airflow |
| @ 0.1 in (25 Pa) | 69 cfm (32 L/s) |
| @ 0.2 in (50 Pa) | 66 cfm (31 L/s) |
| @ 0.3 in (75 Pa) | 64 cfm (30 L/s) |
| @ 0.4 in (100 Pa) | 60 cfm (28 L/s) |
| @ 0.5 in (125 Pa) | 55 cfm (26 L/s) |
| Max. Temperature Recovery | 88% |
| Sensible Effectiveness @ 60 cfm (28 L/s) | 32°F (0°C) 88% |
| Sensible Efficiency @ 60 cfm (28 L/s) | 32°F (0°C) 75% |
| Sensible Efficiency @ 61 cfm (29 L/s) | -13°F (-25°C) 68% |
| VAC @ 60Hz | 120 |
| Watt / Low speed | 59 |
| Watt / High speed | 150 |
| Amp rating | 0.9 |

Sensible Efficiency: Thermal

Effectiveness: Based on temperature differential between the 2 airstreams

Efficiency: Takes into account all power inputs

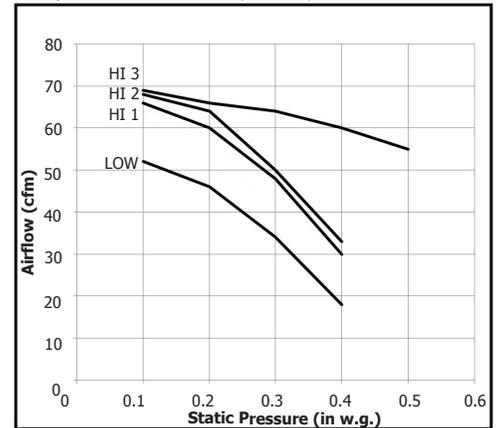

WARRANTY

Units carry a lifetime warranty on the HRV core and a 5 year replacement parts warranty.

NOTE: All specification are subject to change without notice.

All units conform to CSA and UL standards



Date: _____

Tag: _____ Qty: _____

Project: _____

Engineer: _____

Contractor: _____

Supplier: _____

Quote #: _____

Submitted By: _____