


The Fresh Air Ventilation system is designed to introduce fresh air into a home through an intake damper controlled by a micro-processor logic panel. The iO-FAV has single adjustment setup, exhaust fan control option, outdoor temperature and/or humidity limit option and damper override capabilities. It is easy to install and meets ASHRAE Standard 62.2. The iO-FAV kit comes with a control panel, 20VA transformer and round damper. The control panel is available separately (iO-FAVPAN) and can be ordered with additional size dampers.

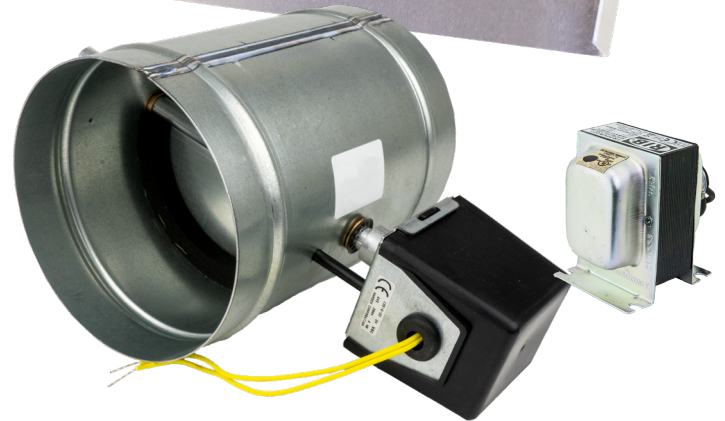

Panel cover included


Features and Benefits:

- Micro-controller logic panel
- Status LEDs
- Single adjustment setup
- Meets ASHRAE Standard 62.2
- Exhaust fan control options
- Shut off switch on panel
- Outdoor temperature and humidity lockout option
- Optional on-demand CO2 ventilation

Warranty:

- 5 Years

Sold Separately



Outdoor Thermostat for high and/or low temperature lockout
iO-ODT



Humidistat
229100

Specifications:

Mounting	Aluminum enclosure with snap-on panel cover
Panel Dimensions	8.00" Height x 6.00" Width x 1.50" Depth
Adjustable Ventilation Schedule	1 – 60 minutes
Power	24VAC
Damper	24VAC, 10VA, power open/spring close actuator



5351 East Thompson Road Suite 142
Indianapolis, IN 46237
P: 888.359.0362
F: 317.489.5204

info@iOhvaccontrols.com
www.iOhvaccontrols.com




Sensors sold separately

Connecting the CO2 sensor to the over-ride terminals on our Fresh Air Ventilation panel activates the On Demand Ventilation function to provide fresh air into areas or rooms with high concentrations of CO2. Contact iO HVAC Controls for engineering and installation instructions and schematics.

The A-SENSE room and duct transmitters monitor the carbon dioxide (CO2) levels in industrial, school, and office type environments.

- Single beam non-dispersive infrared technology
- Relay energizes fresh air ventilation
- Measures the CO2 concentration in the ambient air up to 2,000 ppm
- Limited 5 year manufacturer's warranty

FAV DIAGRAM

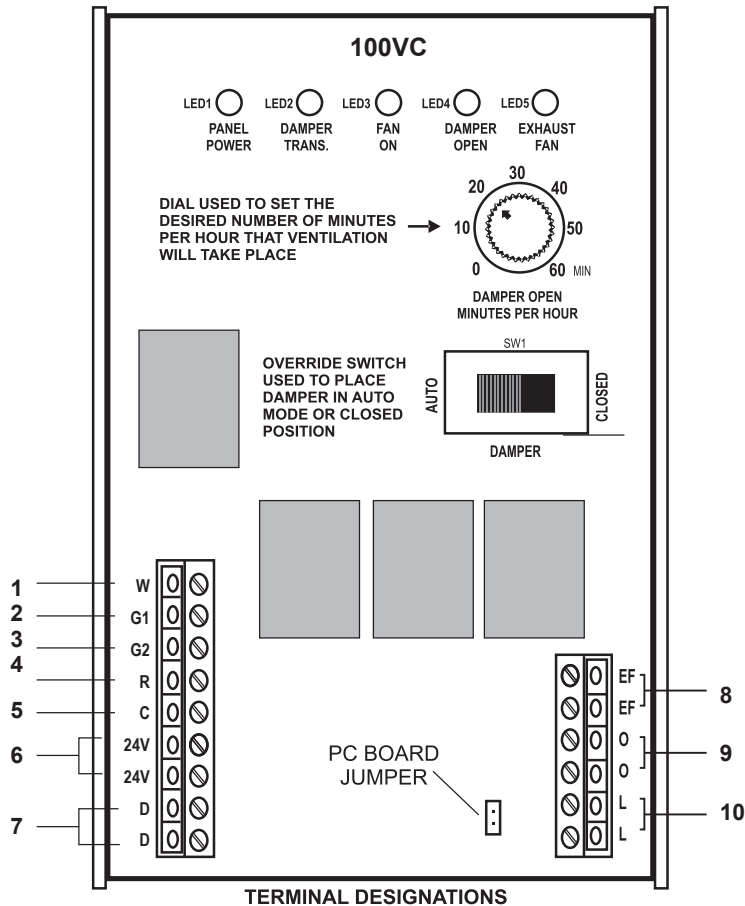

- 1 - WIRES TO 'W' ON THE HVAC UNIT OR 'Y' ON HEAT PUMP
- 2 - WIRES TO 'G' (FAN) ON THE THERMOSTAT
- 3 - WIRES TO 'G' (FAN) ON THE HVAC UNIT
- 4 - WIRES TO 'R' (24V HOT) ON THE HVAC UNIT
- 5 - WIRES TO 'C' (24V COMMON) ON THE HVAC UNIT
- 6 - SEPARATE 24V TO POWER DAMPER
- 7 - 24V TO DAMPER (POWER OPEN / SPRING CLOSED)
- 8 - DRY CONTACT EXHAUST FAN OPTION (N.O.)
- 9 - REMOTE DAMPER OVERRIDE OPTION (N.O.)
- 10- OUTDOOR THERMOSTAT AND/OR HUMIDISTAT OVERRIDE OPTION (JUMPER MUST BE REMOVED)



5351 East Thompson Road Suite 142
Indianapolis, IN 46237
P: 888.359.0362
F: 317.489.5204

info@iOhvaccontrols.com
www.iOhvaccontrols.com